


# Certificate of Analysis

Bacteriostatic Water Lambda Water


Report To:  
**Peptide Crafters**

Compound: Bacteriostatic Water  
Sample ID: Lambda Water  
Laboratory ID: V250701-22 001  
Lot Number: 604  
Date Reported: 7/18/2025

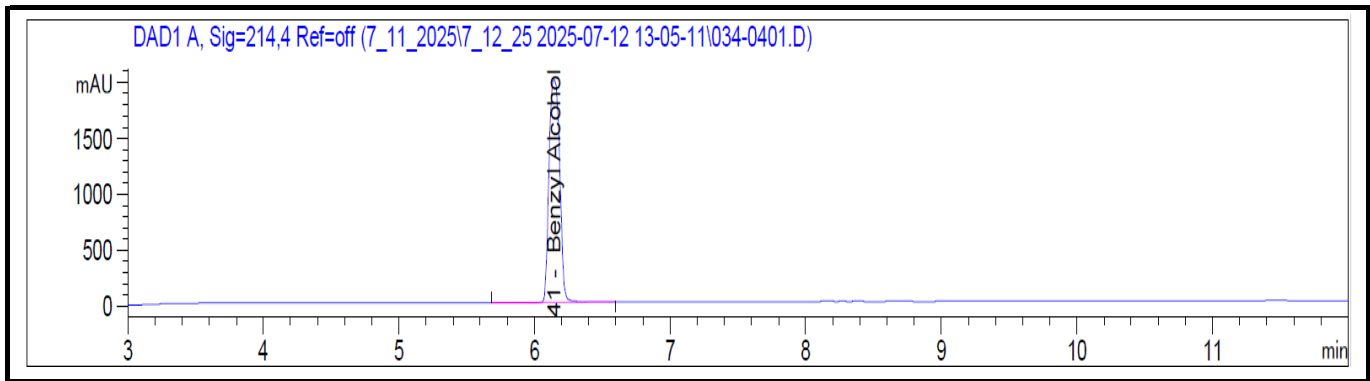

| Analysis               | Method      | Result | Acceptable Range | Pass/Fail* |
|------------------------|-------------|--------|------------------|------------|
| Benzyl Alcohol Content | HPLC-UV/VIS | 0.88%  | 0.72%-1.08%      | Pass       |
| pH                     | AOAC 981.12 | 5.85   | 4.0-7.0          | Pass       |

\* Pass/Fail according to US Pharmacopeia <1231> limits.

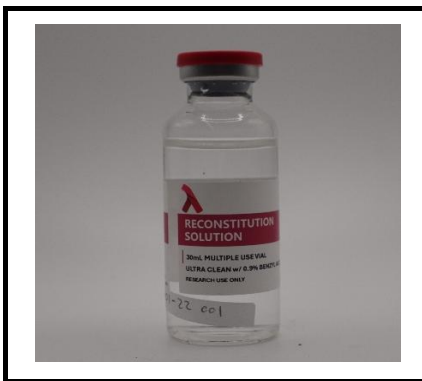


Report By: Dustin Newman, Laboratory Director on 7/18/2025



Approved By: Tori Johnson, Operations Manager on 7/18/2025



Please consult A2LA Certificate #6377.01.01 for a list of accredited tests. Samples were received in acceptable condition. The result(s) in this report relate only to the portion of the sample(s) tested. All analyses were performed consistent with the Vanguard Laboratory Quality Management System. Vanguard Laboratory and its staff did not observe or participate in the sample selection process, and cannot confirm the authenticity of the sample or its representativeness of the associated lot/batch.